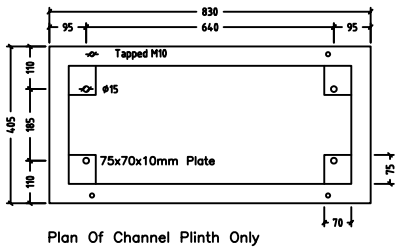

Plan Of Channel Plinth Only

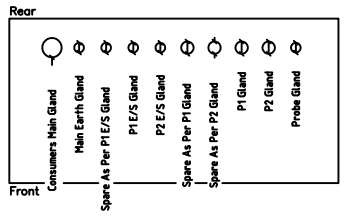

Plan Of Horizontal Divider Only Detailing Minimum Quantity/Size Of Cable Gland Holes

1 – Consumers Main Conduit
2 – Wet Well Conduit (Pump 1)
3 – Wet Well Conduit (Pump 2)
4 – Wet Well Conduit (Probe Only)

Note. Both Earth Stake Conduits Are To Be Provided.

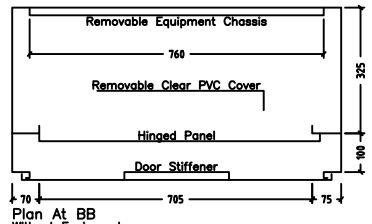

Plan At BB
Without Equipment

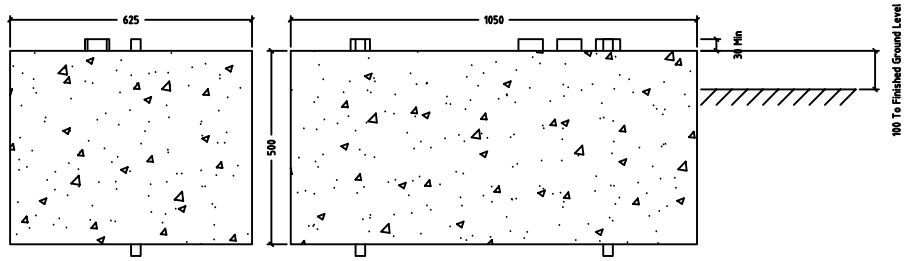

End Elev Of Concrete Plinth Only Front Elev Of Concrete Plinth Only

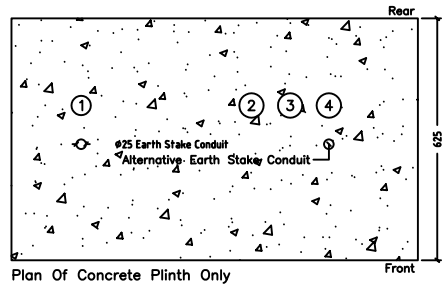

Plan Of Concrete Plinth Only

Note. While Live, Access To The Switchboard Via Door 1 Is Not Restricted To Authorized Persons. The Switchboard Must Therefore Be Constructed And Installed In Accordance With 'SAA WIRING RULES (AS 3000)' To Provide Safe Access To Non Authorized Persons.

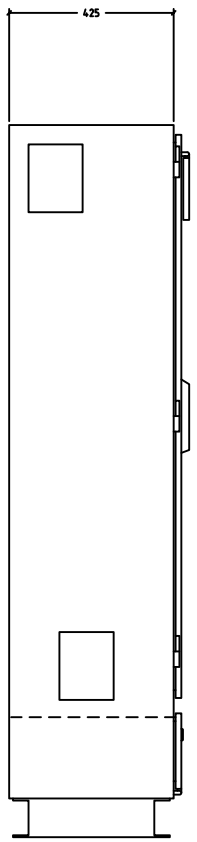

End Elev
Without Lifting Lugs

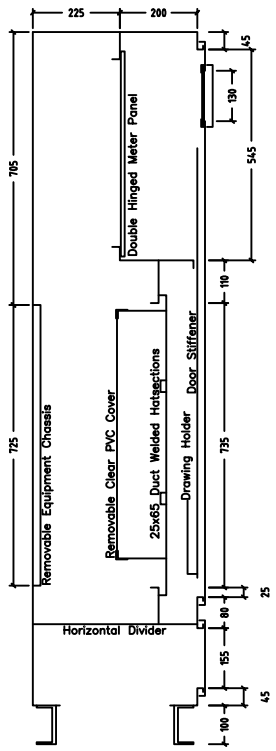

End Elev At AA
Without Equipment

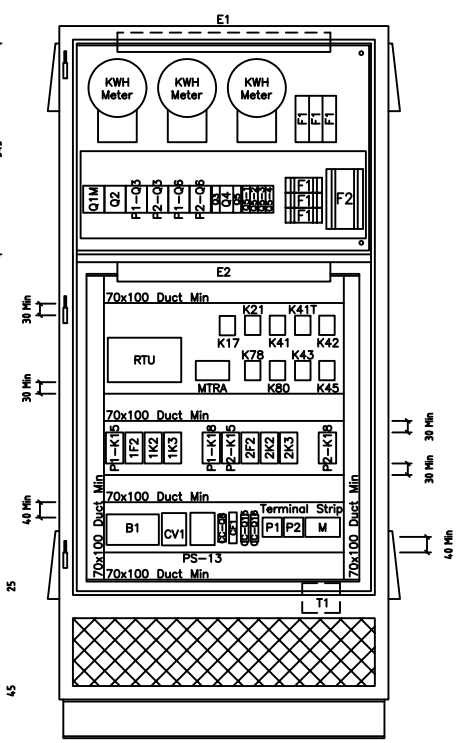

Front Elev
Without Doors, Hinged Panel, Alarm Light, Lifting Lugs

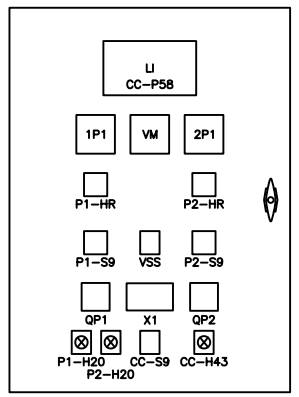

Front View Of Hinged Panel Only
Without Full Length Piano Hinge

Note. 1Q5, 2Q5 To Have Red Padlockable Handle Over A Yellow Escutcheon.

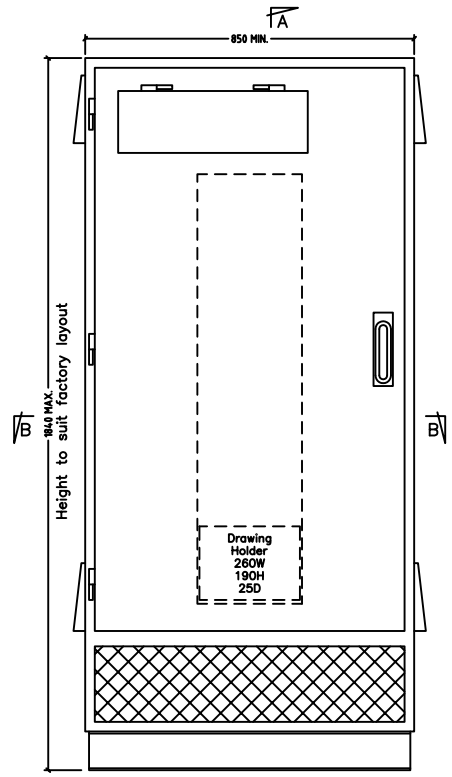

Front Elev
Without Alarm Light, Lifting Lugs

DRAWN BY: GoldCoastWater		PROJECT OFFICER	DESIGN NOT TO BE AMENDED WITHOUT REFERENCE TO DESIGN PROJECT OFFICER			BAR SCALES 0 500mm SCALE 1:10	Gold Coast City Council / GoldCoastWater
		DESIGN/DRAWN LW/GLH				A1 UNREDUCED	
		DWG CHKD			PROJECT FILE NAME G:BUS.REC./06-07-833		
		DES CHKD			RECORDS FILE NO. / SURVEY FOLDER NO.		
			B HOURS RUN METERS ADDED NJK 24/02/06				
TELEPHONE: (07) 5581 6661	DATE	APPROVED	A DRAWING NUMBER WAS 03-07-803 LW 20/04/04		SURVEYED BY / DATE / SURVEY CHKD	DO NOT SCALE, USE FIGURED DIMENSIONS ONLY	GOLD COAST CITY COUNCIL PO BOX 5042, GOLD COAST MC 9729 / ACCEPTED / FOR PROJECT ENQUIRIES REFER ....EXT .... / DATE
			No. AMENDMENT	APPROVED			

SCHEMATIC WIRING DIAGRAM
WASTEWATER PUMP STATION
PANEL LAYOUT

DOL CATEGORY 4

PROJECT No. ABXP
DATE MICROFILMED / /
SHEET 3 OF 3
DRAWING No. 06-07-833B