


DROP BOX & DROP PIPE DETAILS FOR Ø375 MAIN

- NOTES:**
- REFER TO NOTES ON SHEET 1.
 - LARGER SEWER MAIN DROP BOXES SHALL ALLOW STANDARD SEWER PLUG TO BE INSERTED IN MAIN.

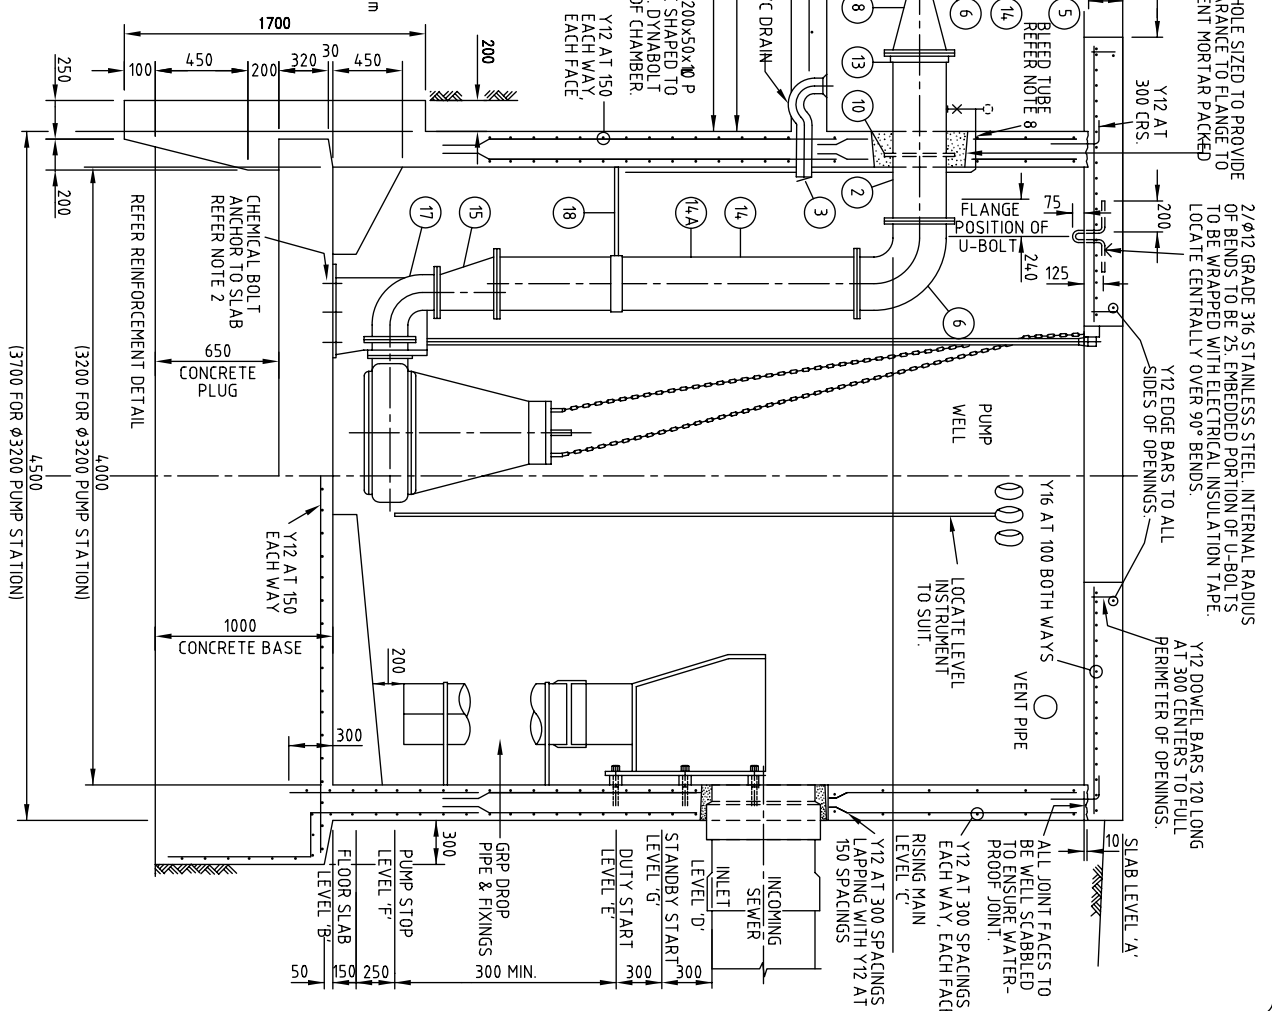

CORED HOLE SIZED TO PROVIDE 80 CLEARANCE TO FLANGE TO BE CEMENT MORTAR PACKED

2/Ø12 GRADE 316 STAINLESS STEEL. INTERNAL RADIUS OF BENDS TO BE 25. EMBEDDED PORTION OF U-BOLTS TO BE WRAPPED WITH ELECTRICAL INSULATION TAPE. LOCATE CENTRALLY OVER 90° BENDS.

Y12 EDGE BARS TO ALL SIDES OF OPENINGS.

Y12 DOWEL BARS 120 LONG AT 300 CENTERS TO FULL PERIMETER OF OPENINGS.

ALL JOINT FACES TO BE WELL SCABLED TO ENSURE WATER-PROOF JOINT.

Y12 AT 300 SPACINGS EACH WAY, EACH FACE RISING MAIN LEVEL 'C'

Y12 AT 300 SPACINGS LAPPING WITH Y12 AT 150 SPACINGS

Y12 AT 100 BOTH WAYS

VENT PIPE

LOCATE LEVEL INSTRUMENT TO SUIT.

SLAB LEVEL 'A'

THIS DRAWING IS NOT TO BE AMENDED WITHOUT REFERENCE TO STANDARDS COMMITTEE

CONTROLLED DOCUMENT

DO NOT SCALE TAKE FIGURED DIMENSIONS ONLY

STANDARD DRAWING

MICROFILMED

No.	AMENDMENT	APPROVED	DATE	ISSUED

DRAWN BY	ISSUED
G.C.W	08/07/08
D. HAYMAN	08/07/08
R. WENT	08/07/08

TYPICAL STANDARD SEWERAGE PUMP STATION 3200 Dia & 4000 Dia (SHEET 2 OF 3)

STANDARD DRAWING No. 08-07-132
ISSUE 2008 EDITION

