


THREE ROWS OF METER ASSEMBLIES – THREE OPTIONS

NOTE:

1. EASEMENT WIDTH FOR EACH ROW OF METER ASSEMBLIES SHALL COMPLY WITH THE TWO CONDITIONS WHICH ARE MINIMUM CLEARANCE OF 300 FOR ONE SIDE AND 900 CLEARANCE FOR OTHER SIDE ALONG THE COMPLETE METER ASSEMBLY.
2. EASEMENT SIZES AS TABLED REFER TO STD DWG 11-154.
3. LARGER SIZE ASSEMBLIES e.g. FIRE FLOWS ARE INSTALLED AS UPPER STACK. SMALLER SIZE ASSEMBLIES e.g. DOMESTIC FLOWS ARE INSTALLED AS LOWER STACK.

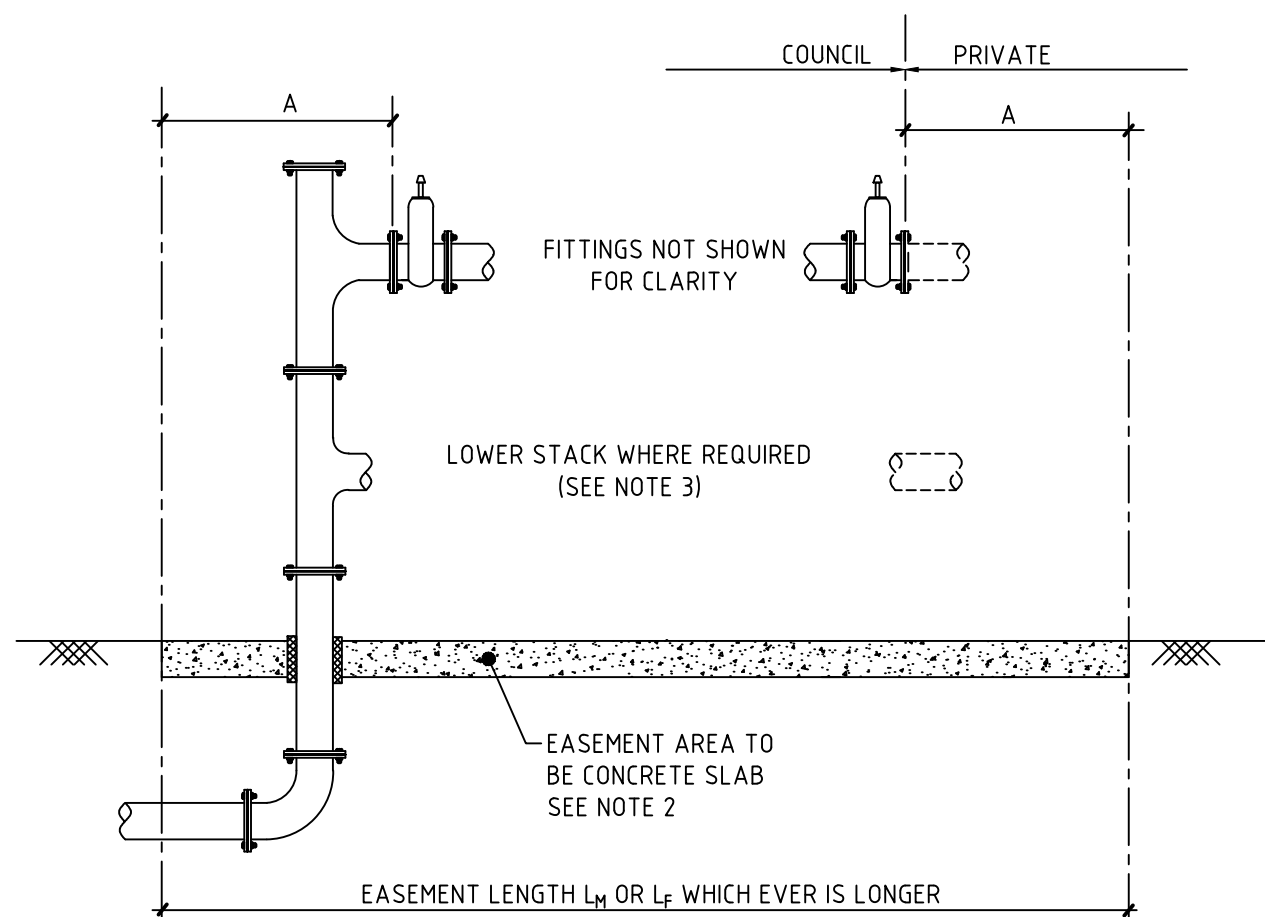


SECTION VIEW

(A)

LEGEND:

X GATE VALVES

M WATER METER AND OTHER FITTINGS

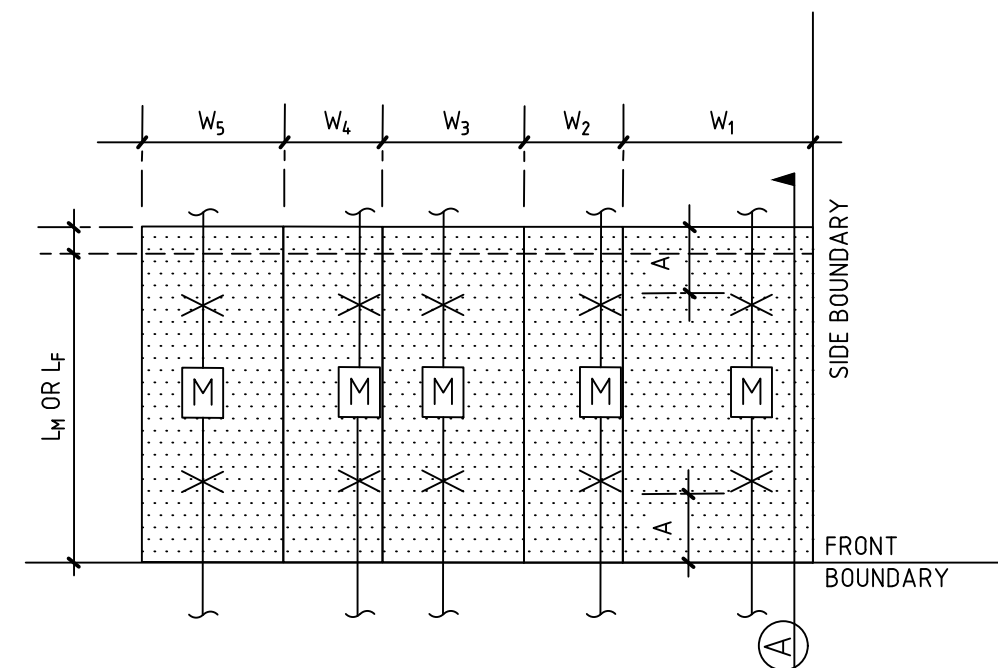

FOUR AND MORE ROWS OF METER ASSEMBLIES (SEE NOTE 1)

DRAWN BY: D. LI					
CHECKED BY: N. PEARSON					
APPROVED BY: D. LI					
	B	SECTION VIEW AMENDED. NOTE 4 REMOVED. SIZE A1 CHANGED TO A.	31/7/21	DL	
	A	NEW NOTE 4 AND GATE VALVE. NOTE 3 AND SECTION VIEW UPDATED.	21/2/20	DL	
	No.	REVISION	DATE	APPROVED	

SCALE: DO NOT SCALE
TAKE FIGURED DIMENSION ONLY

THIS DRAWING IS NOT TO BE AMENDED WITHOUT WATER, WASTE AND ENERGY ACCEPTANCE

CITY OF GOLD COAST
WATER, WASTE AND ENERGY

PO BOX 5042, GOLD COAST MC 9729

STANDARD DRAWING

TYPICAL EASEMENT CONFIGURATIONS
THREE OR MORE ROWS OF
METER ASSEMBLY

ORIGINAL ISSUE DATE: 31/01/2019
SHEET OF
DRAWING No: 11-155
REV: B