


Coomera Indoor Sports Centre – GPO, 3 Phase & DB Identifiers

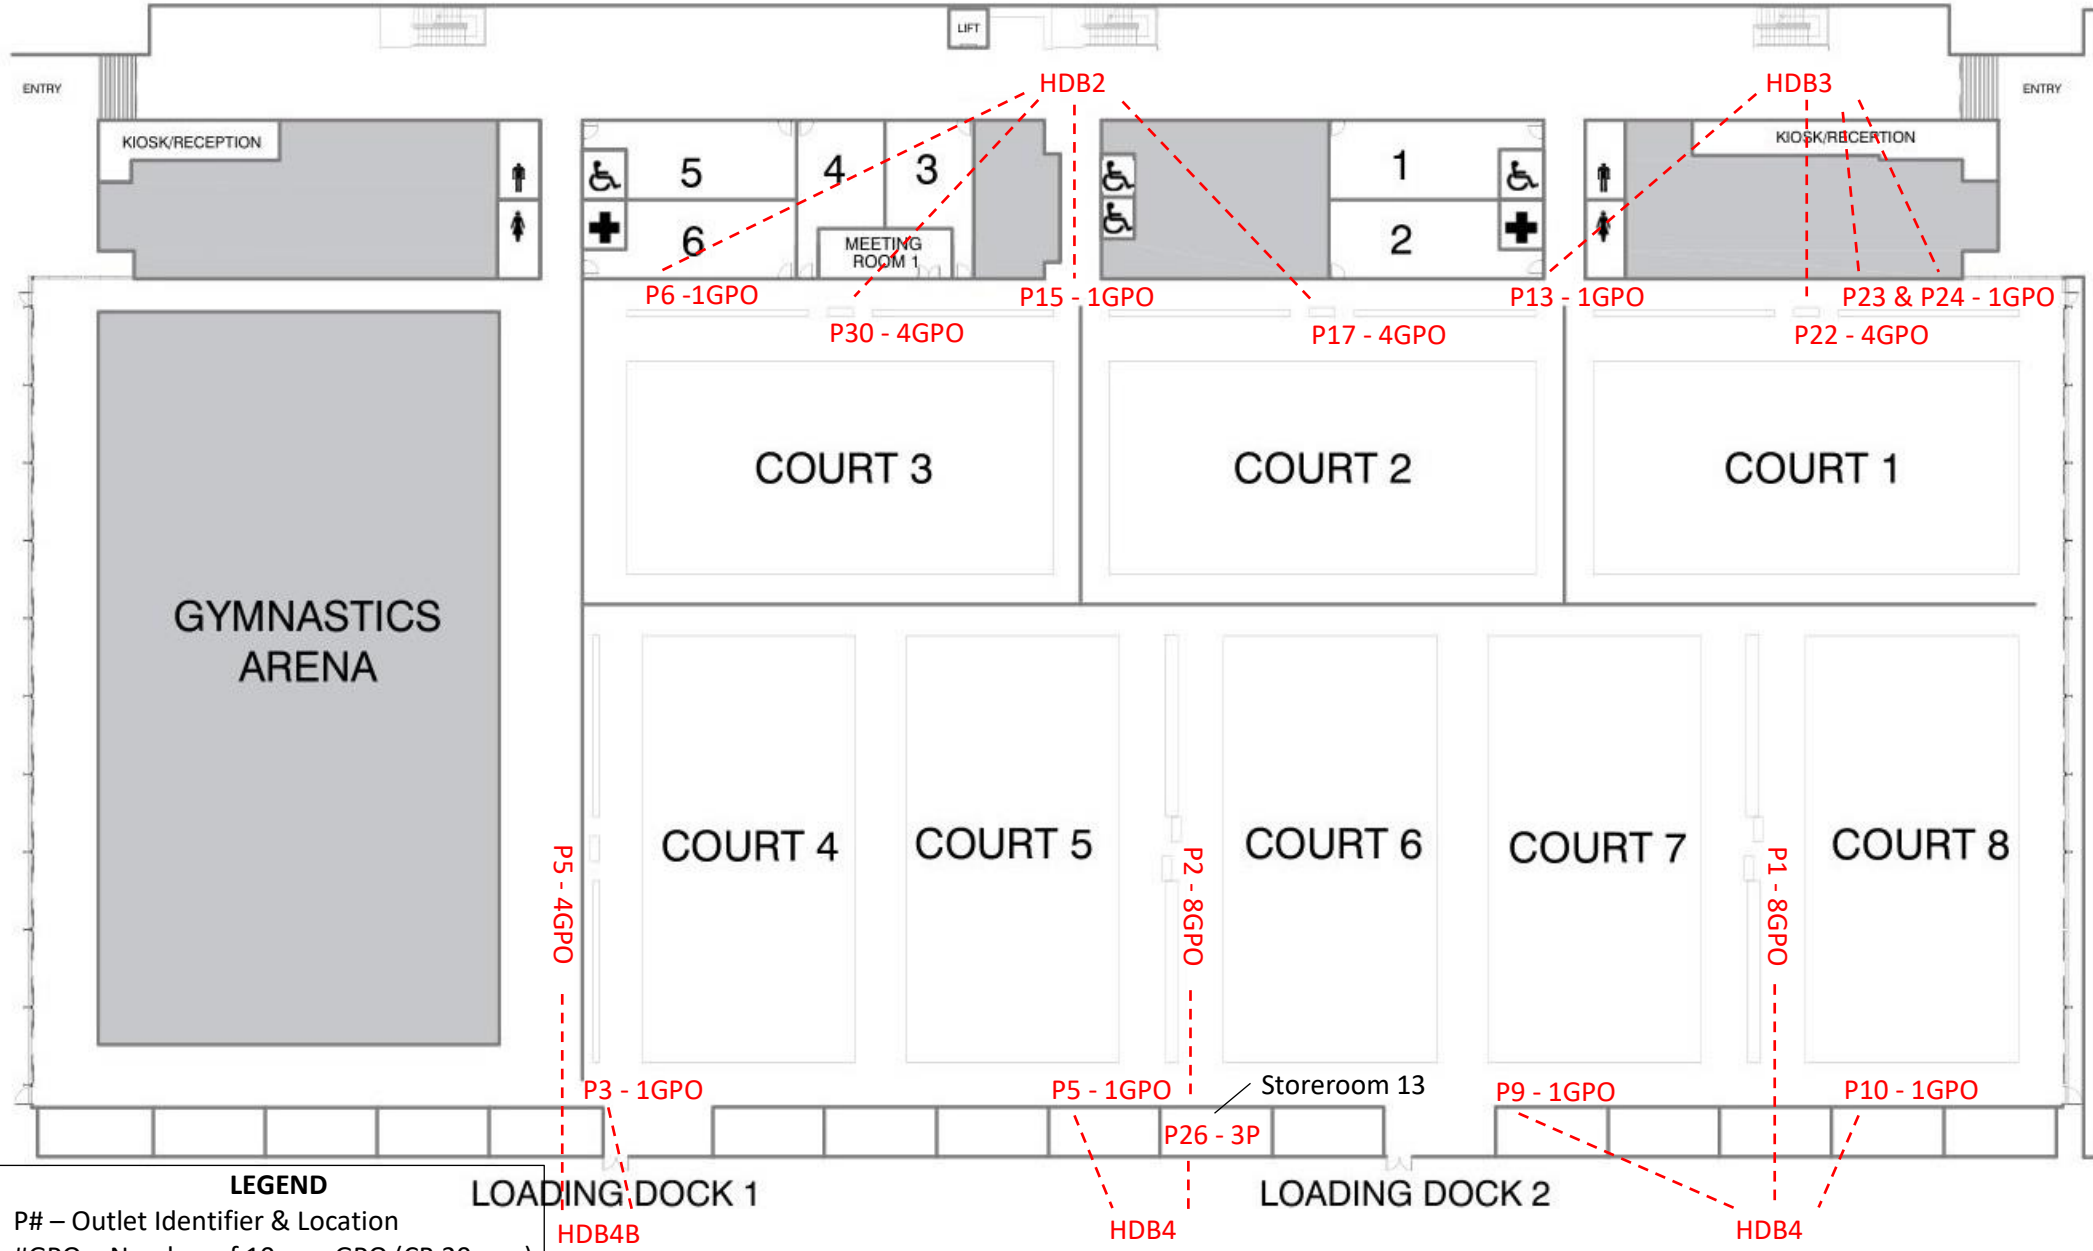

LEGEND
 P# – Outlet Identifier & Location
 #GPO – Number of 10amp GPO (CB 20amp)
 HDB# – Distribution Board Identifier
 3P – 3phase 415V – 5pin Outlet (CB 20amp)