NOTE:
DO NOT INSTALL SOAKAGE TRENCHES FOR GREASE TRAP IN VEHICULAR TRAFFIC AREAS.

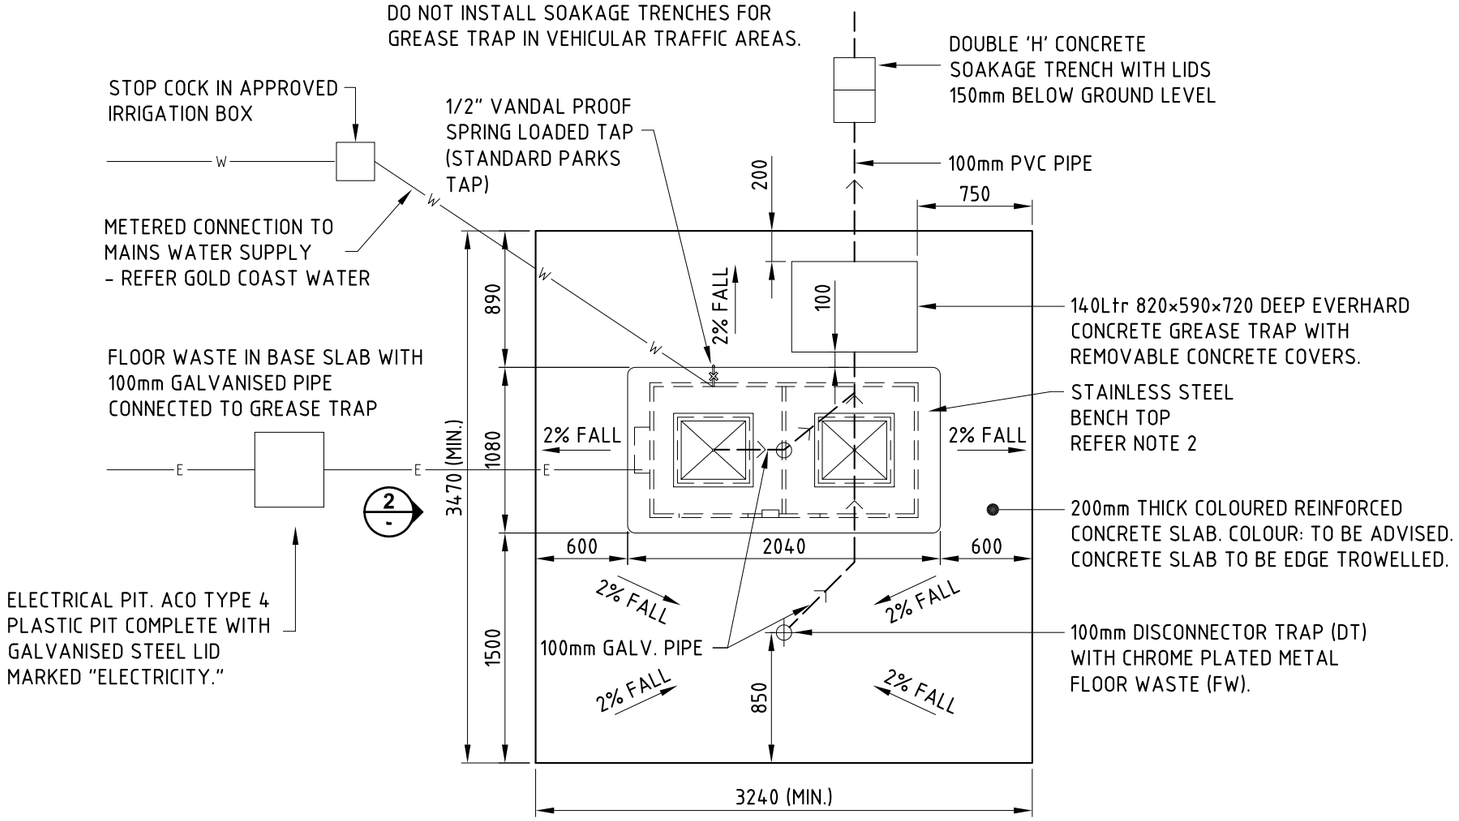

PLAN

GENERAL NOTES

1. S.S. DISTRIBUTION BOARD SIMILAR TO B&R MONARCH IP-13132/5 & IPFP-1313 (OR EQUIV. IP66) RECESSED OR SURFACE MOUNTED AS REQUIRED, CONNECTED TO MAINS POWER SUPPLY. REFER TO STD. DWG. No. 58041.005 FOR DETAILS. REFER TO SINGLE LINE DIAGRAM & EARTHING DETAILS ON STD. DWG. No. 58090.003 FOR ELECTRICAL INSTALLATION DETAILS.
2. GHARKSO ELECTRICAL DOUBLE BARBEQUE OR APPROVED EQUIVALENT. REFER TO MANUFACTURERS DETAILS FOR INSTALLATION.
3. FLUSH MOUNTED WEATHERPROOF OUTLET ATTACHED TO BBQ WITH RCD E.G. CLIPSAL 56C315 RC OR APPROVED EQUIVALENT ONLY.
4. STAINLESS STEEL (GRADE 316) FIXINGS FOR ALL STAINLESS SHEET METALWORK. PROVIDE ANTI-GAWLING LUBRICANT TO ALL BOLTS AND SCREW FIXINGS.
5. ALL PIPEWORK IN ACCORDANCE WITH A.S.3500 NATIONAL PLUMBING CODE.
6. CLIP PIPEWORK TO INSIDE OF WALL.
7. ELECTRICALLY BOND SLAB REINFORCEMENT USING NES WACON - WACON EQUIPOTENTIAL BONDING CONNECTOR (OR EQUIVALENT).

WARNING
BEWARE OF UNDERGROUND SERVICES

ENSURE ALL UNDERGROUND SERVICES IN THE AREA OF CONSTRUCTION ARE ACCURATELY LOCATED IN CONSULTATION WITH SERVICE AUTHORITY PERSONNEL PRIOR TO COMMENCEMENT OF WORK.

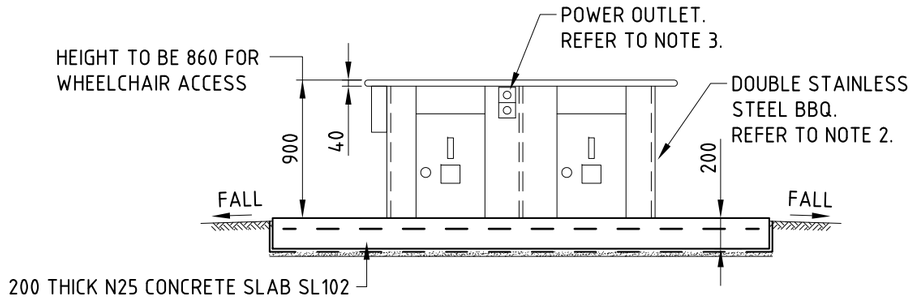

ELEVATION 1

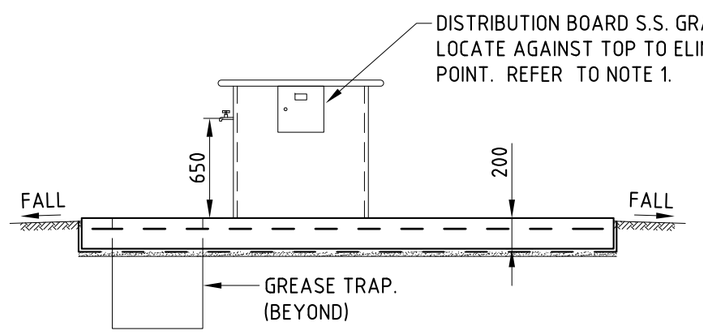

ELEVATION 2

Gold Coast City Council GOLD COAST CITY COUNCIL PO BOX 5042 GOLD COAST MC 9729	THIS DRAWING IS NOT TO BE AMENDED WITHOUT REFERENCE TO STANDARDS COMMITTEE			CONTROLLED DOCUMENT	DO NOT SCALE TAKE FIGURED DIMENSIONS ONLY
					DRAFTING BY TECHNICAL SERVICES BRANCH
					PASSED – COORDINATOR OPEN SPACE ASSETS SIGNED: NAME: CAMERON TAYLOR DATE: 6/12/12
					APPROVED – MANAGER PARKS & RECREATIONAL SERVICES SIGNED: NAME: RON JACOBS DATE: 6/12/12
	No.	AMENDMENT	APPROVED	DATE	ISSUED

STANDARD DRAWING

DOUBLE STAINLESS STEEL BBQ

MICROFILMED

STANDARD DRAWING No.
13-05-018

ISSUE
2013 EDITION