


NOTES

1. BENCHING NOT SHOWN.
2. SEWERS DOWNSTREAM OF PRESSURE MAIN DISCHARGE MANHOLE SHALL BE OF NON-CORROSIVE PIPE FOR THE GREATER LENGTH OF 90m OR THE TOTAL LENGTH OF THE RUNS CONNECTING THE TWO MANHOLES DOWNSTREAM OF THE DISCHARGE MANHOLE.
3. THE DISCHARGE MANHOLE AND ANY MANHOLE DOWNSTREAM WITHIN 90m SHALL BE INTERNALLY COATED WITH A PROTECTIVE COATING.
4. FOR PROTECTIVE COATING REQUIREMENTS REFER TO COUNCIL'S STANDARD SPECIFICATION SS1.
5. DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.



PART SECTIONAL ELEVATION
PRESSURE MAIN DISCHARGE MANHOLE

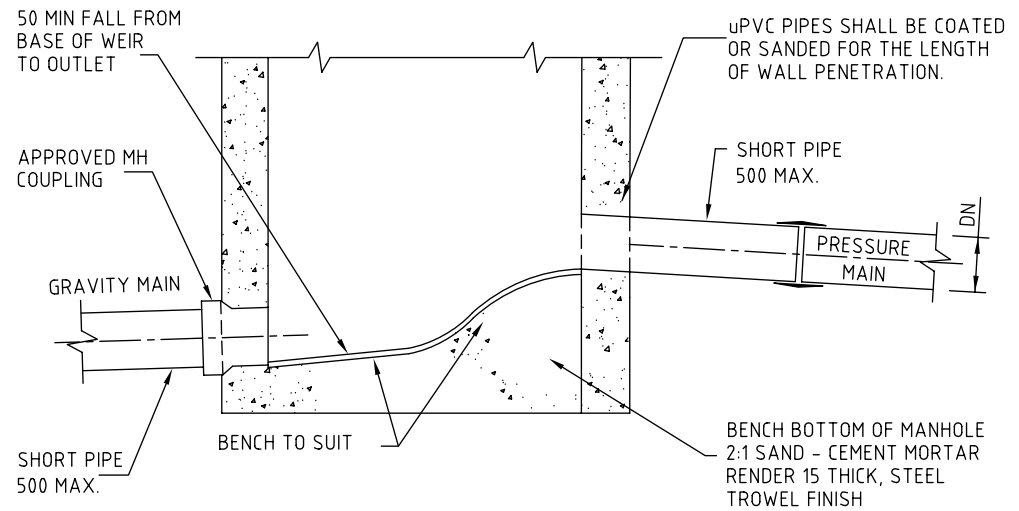

Gold Coast City Council
GOLD COAST CITY COUNCIL
PO BOX 5042
GOLD COAST MC 9729

THIS DRAWING IS NOT TO BE AMENDED WITHOUT REFERENCE TO STANDARDS COMMITTEE

CONTROLLED DOCUMENT

DO NOT SCALE
TAKE FIGURED DIMENSIONS ONLY

STANDARD DRAWING

MICROFILMED

DRAWN BY	G.C.W
PASSED	D. HAYMAN 08/07/08
APPROVED	R. WENT 08/07/08

**DETAIL OF SEWERAGE
PRESSURE MAIN DISCHARGE
TO GRAVITY SYSTEM**

STANDARD DRAWING No.	08-07-117
ISSUE	2008 EDITION

No.	AMENDMENT	APPROVED	DATE	ISSUED