


1. FOR TYPICAL FOOTPATH VERGE ALLOCATIONS FOR PUBLIC UTILITIES REFER TO G.C.C.C STD DWGS 05-02-005.
2. THE MAXIMUM DISTANCE BETWEEN HYDRANTS SHALL BE 80m.
3. A HYDRANT SHALL BE PROVIDED AT THE END OF ALL LINES. FOR HYDRANT DETAILS REFER TO G.C.C.C STD DWGS 08-06-122 AND 08-06-123.
4. STOP VALVES SHALL BE PROVIDED AT ALL BRANCHES, TEES & CROSSES AND SECTION VALVES SHALL BE GENERAL SPACED AT MULTIPLES OF 50 PROPERTY BLOCKS..
5. SYSTEM SECTION VALVES SHALL BE SPACED AT MULTIPLES OF 100 PROPERTY BLOCKS..
6. PRIOR TO COMMENCING WORK ON SITE THE CONTRACTOR SHALL DETERMINE THE LOCATION OF ALL EXISTING PUBLIC UTILITIES.
7. THE CONTRACTOR SHALL ENSURE THAT THE WORKS ARE CARRIED OUT IN ACCORDANCE WITH ALL REQUIREMENTS OF ACTS, REGULATIONS AND LOCAL LAWS.
8. FOR TYPICAL PROPERTY SERVICE INSTALLATIONS DETAILS REFER TO G.C.C.C STD DWG No. 08-06-108 AND 08-06-109.
9. FOR CONSTRUCTION TOLERANCES REFER TO COUNCIL'S STANDARD SPECIFICATION SS2.
10. FOR INDUSTRIAL & COMMERCIAL ARRANGEMENTS REFER TO G.C.C.C STD DWG No. 08-06-003.
11. DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.



- WATER MAIN
- FIRE HYDRANT
- - - SERVICE CONDUIT
- × STOP VALVE FL-FL
- REDUCER PIPE
- ⊢ DEAD END CAP
- - - NOMINAL KERB LINE

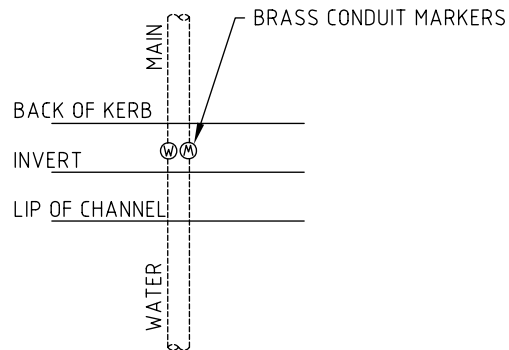

Gold Coast City Council
 GOLD COAST CITY COUNCIL
 PO BOX 5042
 GOLD COAST MC 9729

THIS DRAWING IS NOT TO BE AMENDED WITHOUT REFERENCE TO STANDARDS COMMITTEE				CONTROLLED DOCUMENT	DO NOT SCALE TAKE FIGURED DIMENSIONS ONLY
No.	AMENDMENT	APPROVED	DATE	ISSUED	DRAWN BY G.C.W
					PASSED D. HAYMAN 08/07/08
					APPROVED R. WENT 08/07/08

STANDARD DRAWING
 TRADITIONAL
 WATER RETICULATION
 TYPICAL ARRANGEMENT DETAILS

MICROFILMED
STANDARD DRAWING No. 08-06-001
ISSUE 2008 EDITION