


NOTES:

- FOR EXCAVATION, BEDDING AND BACKFILL REQUIREMENTS REFER COUNCILS STANDARD SPECIFICATION SS2.
- A GEOTEXTILE BARRIER SHALL BE PROVIDED AT THE INTERFACE OF BEDDING ZONE 3 AND BACKFILL.
- THE PLUG SHALL BE GRADE N15 CONCRETE (ZERO SLUMP) PLACED IN 100 LAYERS AND COMPACTED.
- FOR PAVEMENT DETAILS REFER COUNCIL STANDARD SPECIFICATION SS7.
- THE ASPHALT SURFACING SHALL COMPLY WITH COUNCILS STANDARD SPECIFICATION SS8.
- THE VERTICAL DEVIATION FROM A STRAIGHT EDGE PARALLEL TO THE CENTRE LINE OF THE EXISTING ROAD SHALL NOT EXCEED 5 MILLIMETRES.
- FOR STATE CONTROLLED ROADS THE BEDDING ZONES 1, 2 AND 3 SHALL COMPLY WITH THE DETAILS ON THIS DRAWING. BACKFILL AND PAVEMENT SHALL COMPLY WITH REQUIREMENTS OF MAIN ROADS.
- THE ALIGNMENT OF ALL PIPES SHALL BE MARKED BY A COLOURED TAPE BURIED AT A DEPTH OF 300 mm MINIMUM. THE TAPE SHALL CONTAIN A CONTINUOUS METAL STRIP.
- DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.

| ROAD TYPE | A | B |
|-----------|-----|-----|
| MINOR | 200 | 150 |
| MAJOR | 300 | 250 |

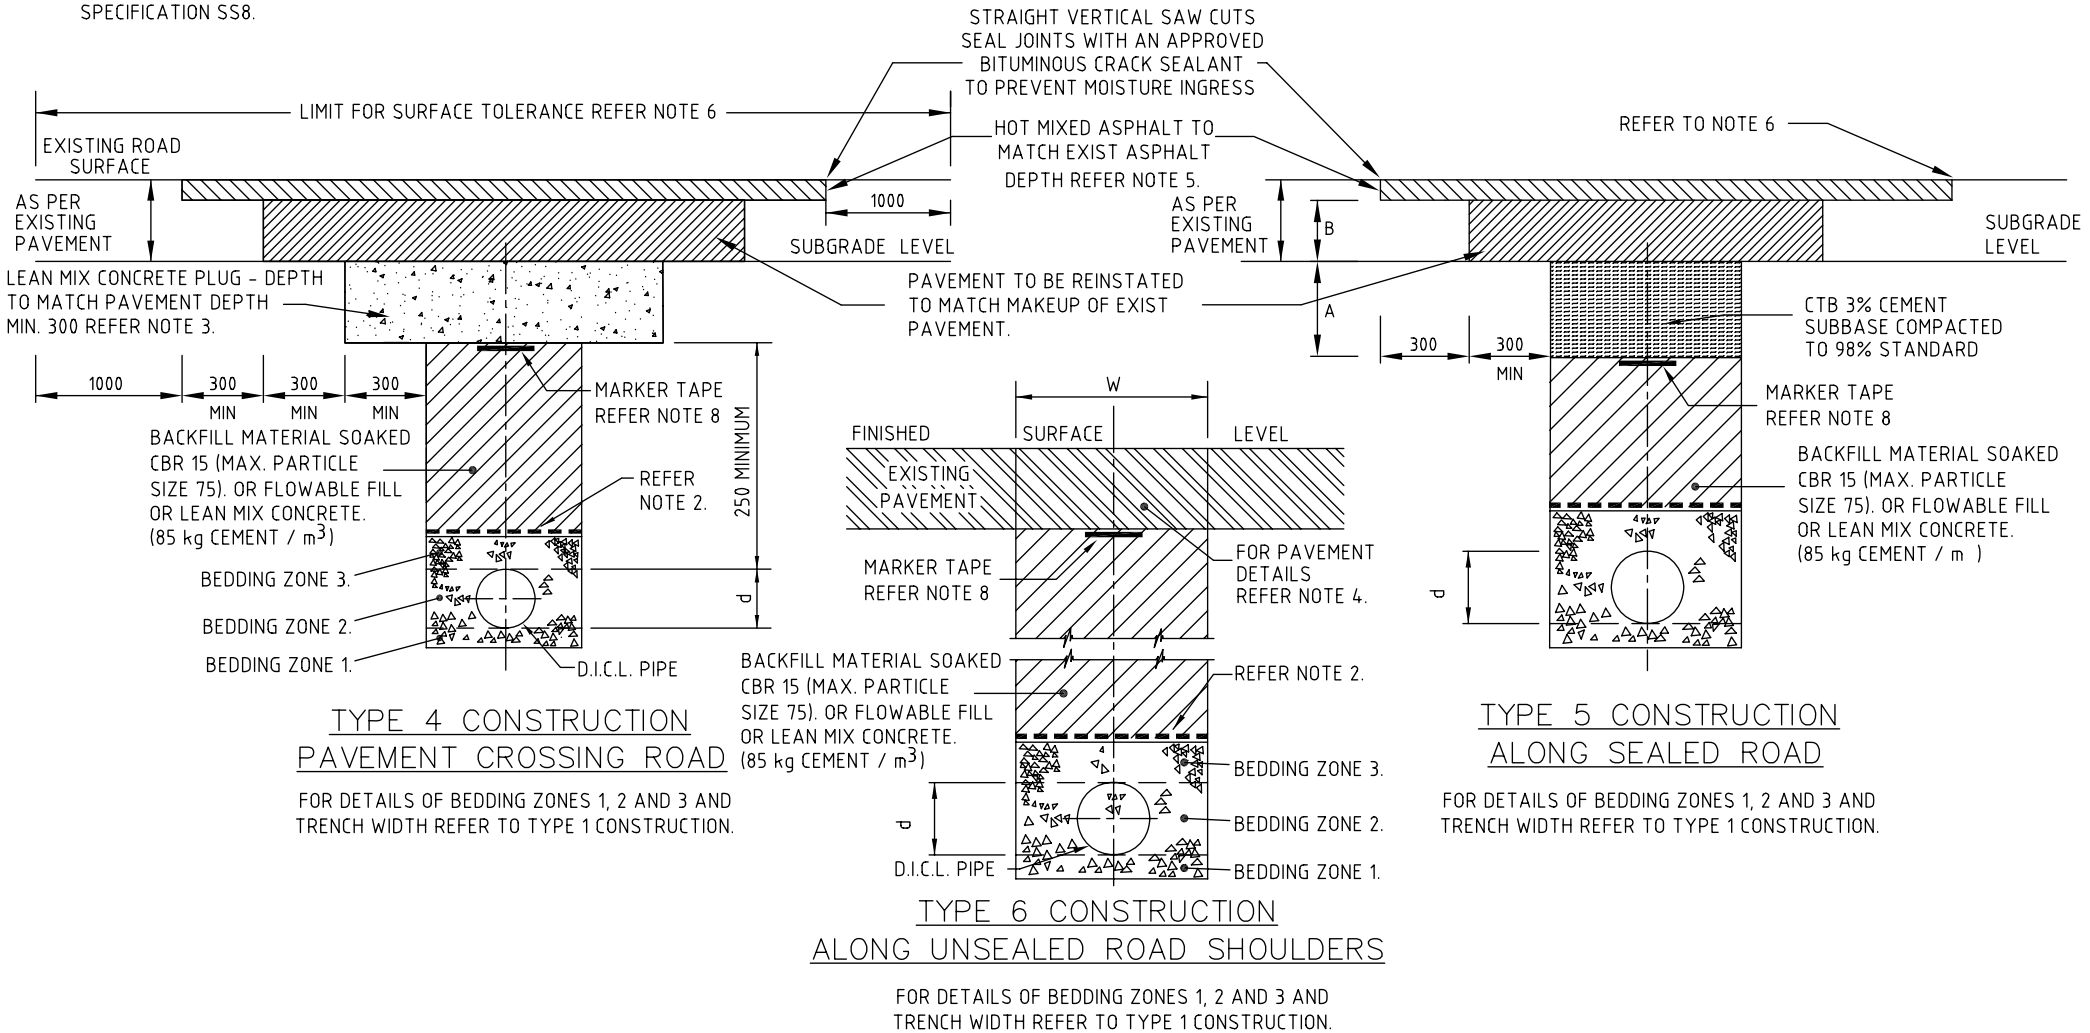

Gold Coast City Council
GOLD COAST CITY COUNCIL
PO BOX 5042
GOLD COAST MC 9729

| THIS DRAWING IS NOT TO BE AMENDED WITHOUT REFERENCE TO STANDARDS COMMITTEE | | | |
|--|-----------|----------|------|
| No. | AMENDMENT | APPROVED | DATE |
| | | | |

| CONTROLLED DOCUMENT | DO NOT SCALE TAKE FIGURED DIMENSIONS ONLY | |
|---------------------|---|----------|
| DRAWN BY | G.C.W | |
| PASSED | D. HAYMAN | 08/07/08 |
| APPROVED | R. WENT | 08/07/08 |

STANDARD DRAWING

WATER PRESSURE MAIN TRENCH AND BEDDING DETAILS WITHIN EXISTING ROADS

| MICROFILMED |
|-----------------------------------|
| STANDARD DRAWING No. 08-06-102 |
| ISSUE 2008 EDITION |