


FLUSHING POINT FITTINGS			
	VALVE F-F	COUPLING-M	DUST CAP
POTABLE	1 1/2" BRASS GATE VALVE WITH BRASS HAND WHEEL	38mm BRASS STORZ X 1 1/2" BSP	YES
RECYCLED	1 1/2" BRASS BALL V SS316 HANDLE, NUT AND SPINDLE	POLY CAMLOCK 1 1/2" CAMLOCK	YES



NOTES :

1. ELECTROFUSION FITTINGS ONLY AFTER JULY 2005.
2. PE PIPES AND FITTINGS SHALL BE PE100
3. RISER PIPE SHALL BE STRAIGHT PIPE CUT TO REQUIRED LENGTH, NO COIL PIPE SHALL BE ACCEPTED.
4. DEEPER INSTALATIONS WILL REQUIRE THE LENGTH OF THE RISER PIPE TO BE INCREASED AS APPROPRIATE.
5. GUIDELINES ON THE USE AND INSTALLATION OF PE SYSTEMS IS AVAILBLE FROM WSA 01-2001.
6. COUNCIL HAS NOMINATED SPECIFIC COMPONENTS TO ASSIST INSTALLERS, COUNCIL APPROVED ITEMS OF EQUAL PERFORMANCE ARE ACCEPTABLE.
7. ALIGN THE VALVE, WITHIN THE FOOTWAY/ VERGE, TO THE TANGENT OF THE PROPERTY BOUNDARY.
8. ALL RESILIENT SEATED SLUICE VALVES SHALL HAVE "ANTI-CLOCKWISE" SPINDLES FOR CLOSING.

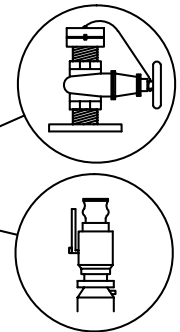

THIS DRAWING IS NOT TO BE AMENDED WITHOUT REFERENCE TO STANDARDS COMMITTEE			CONTROLLED DOCUMENT	DO NOT SCALE TAKE FIGURED DIMENSIONS ONLY
No.	AMENDMENT	APPROVED	DATE	ISSUED

DRAWN BY	G.C.W
PASSED	D. HAYMAN 08/07/08
APPROVED	R. WENT 08/07/08

STANDARD DRAWING
DUAL WATER RETICULATION SYSTEM
STANDARD DETAILS
ELECTROFUSION FITTINGS

MICROFILMED
STANDARD DRAWING No. 08-06-113
ISSUE 2008 EDITION